




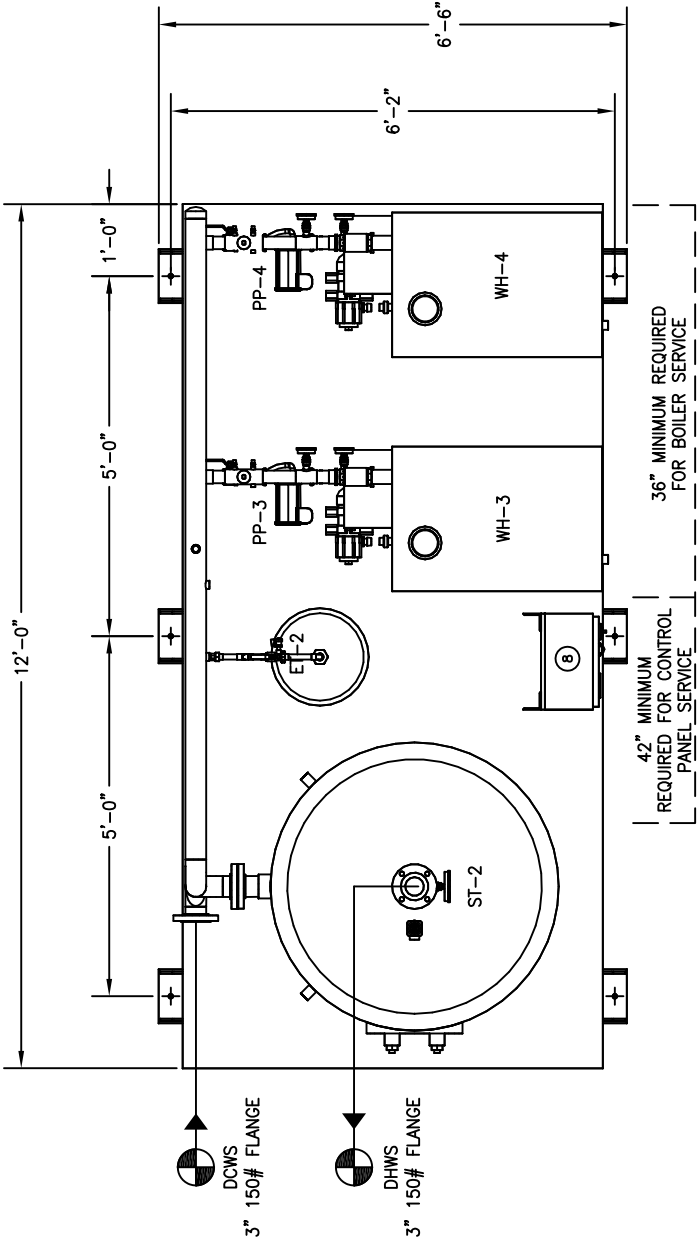

TOP VIEW

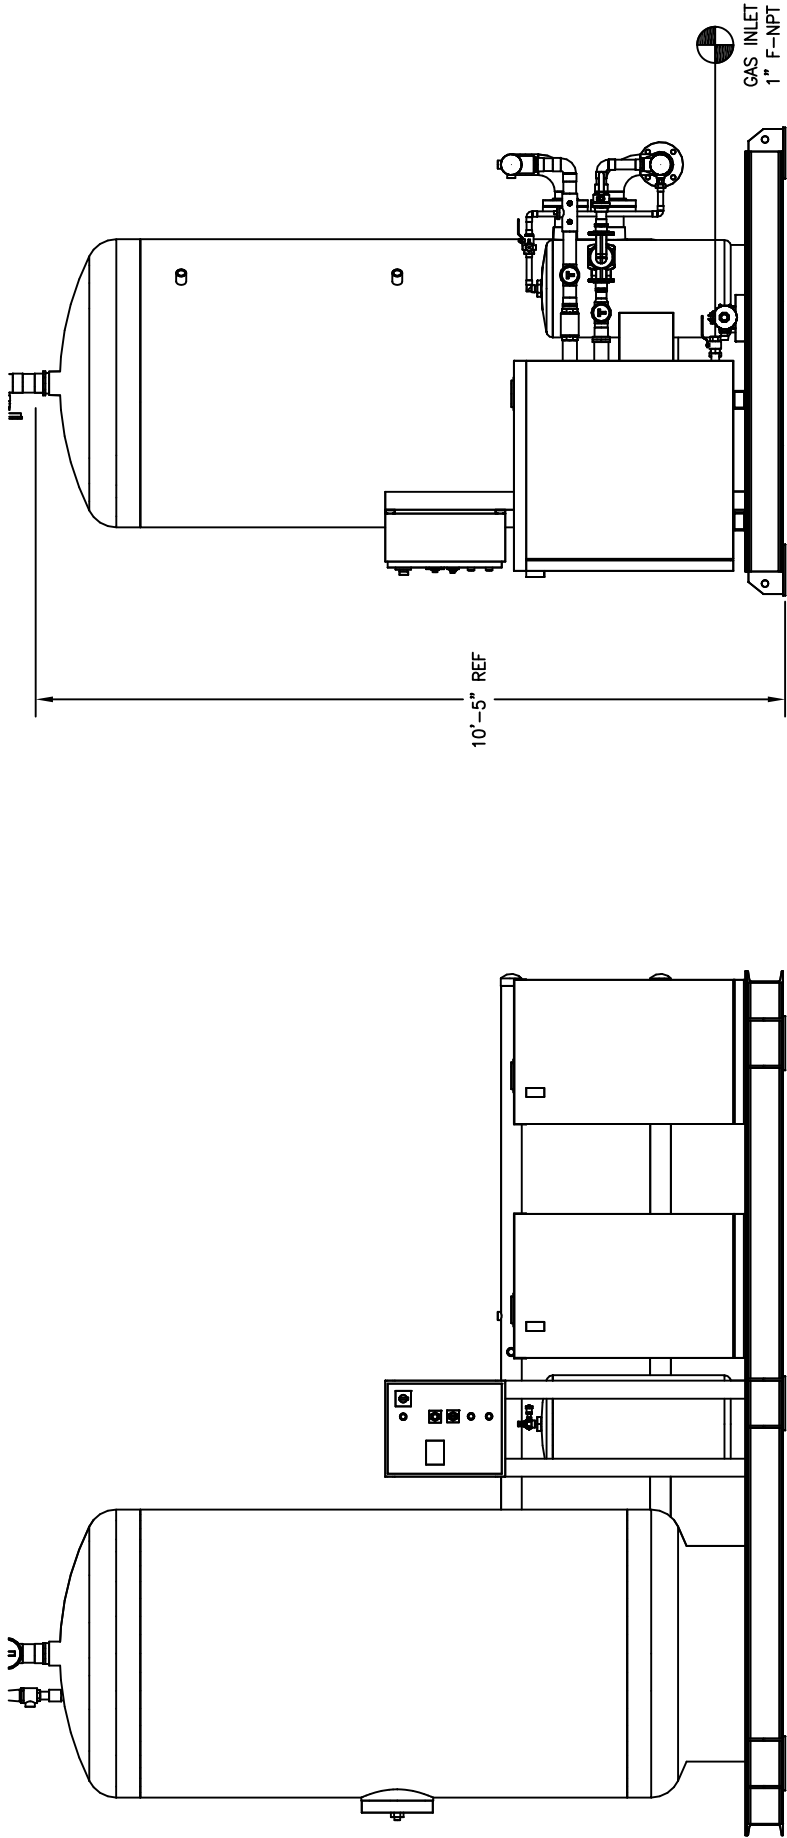

FRONT VIEW

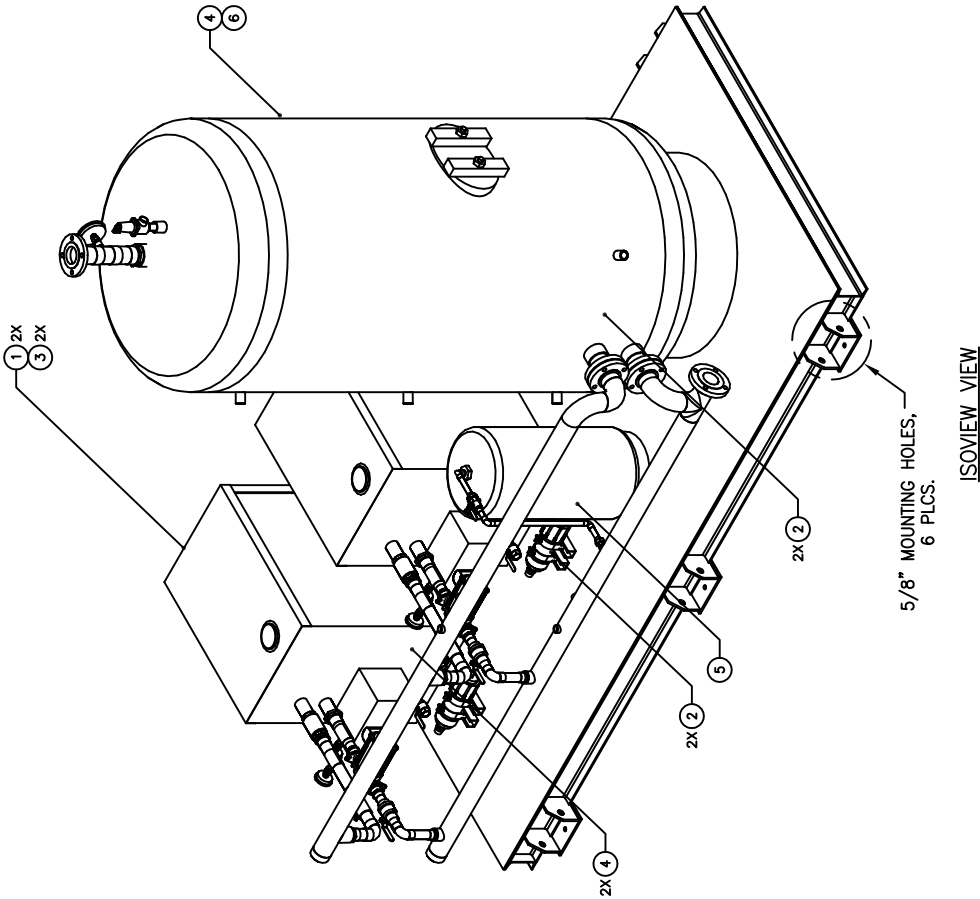

ISOVIEW VIEW

DESIGN NOTES:

- (1) COMPLETE SYSTEM TO BE HYDRO TESTED TO 125 PSI PRIOR TO SHIPPING.
- (2) STEEL FRAME AND COMPONENTS TO RECEIVE TWO COATS OF GRAY MACHINE ENAMEL.
- (3) ALL WELDED WATER PIPING TO BE WELDED IN ACCORDANCE TO ASME B31.9
- (4) COMPLETE PACKAGE SYSTEM TO BE UL LISTED.

☯ = DENOTES CONTRACTOR POINT OF CONNECTION



LISTED  
PACKAGED PUMPING SYSTEMS  
&  
HEAT TRANSFER SYSTEMS

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FLOWTHERM SYSTEMS, A DIVISION OF CALIFORNIA HYDRONICS CORP. COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED FOR ANY PURPOSES WITHOUT THE WRITTEN PERMISSION OF CALIFORNIA HYDRONICS CORP.

APPROXIMATE SHIPPING WEIGHT: - LBS.  
APPROXIMATE OPERATING WEIGHT: - LBS.

BY DATE

DESCRIPTION

REV

JOB NAME:

CONTRACTOR:

DRWN. DATE CKD. APPROVED

TOLERANCES UNLESS OTHERWISE SPECIFIED  
DEC. FRAC. ANGLE SIZE SCALE  
.500" 1/2" 5' D

FlowTHERM  
Systems

DRAWING TITLE:  
DOMESTIC HOT WATER SYSTEM

FAB No. DRAWING No. REV