

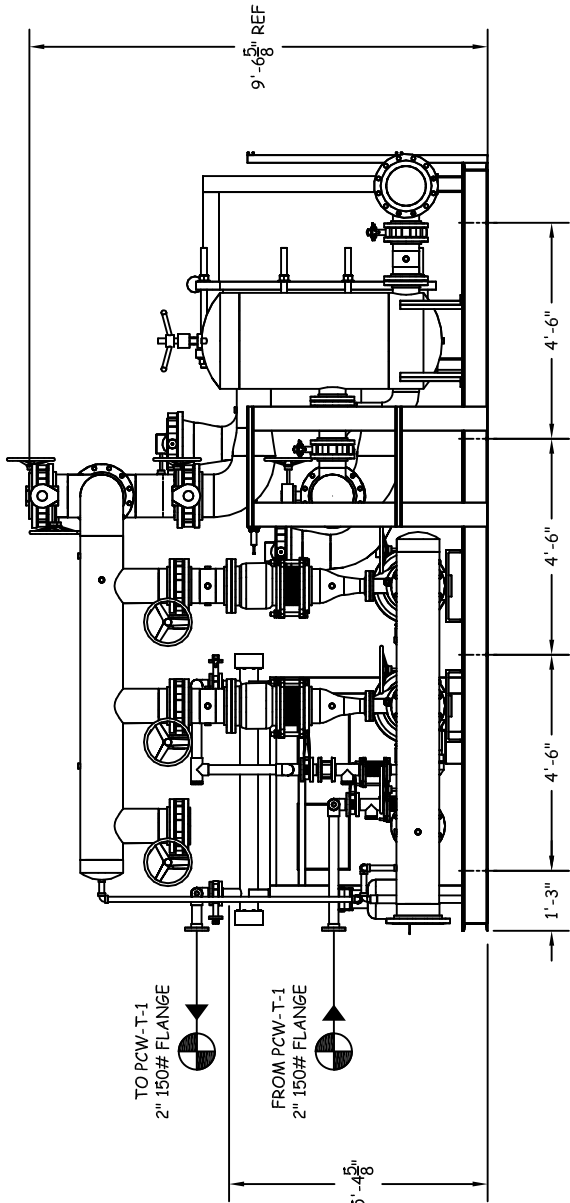
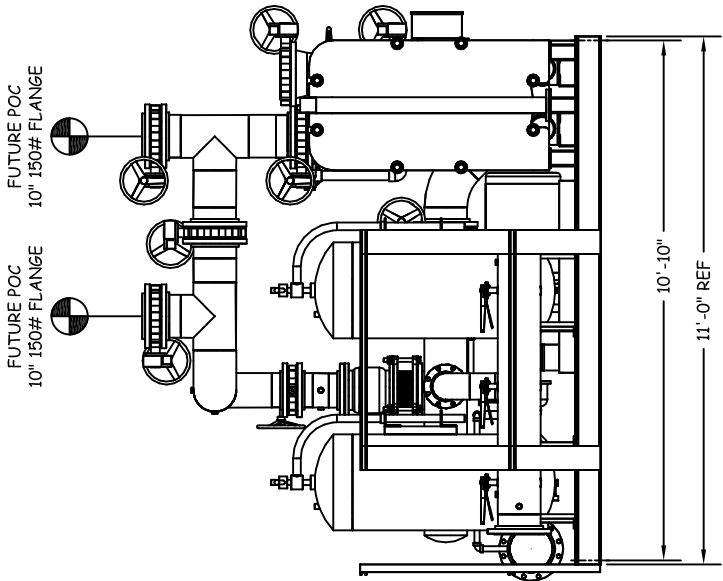


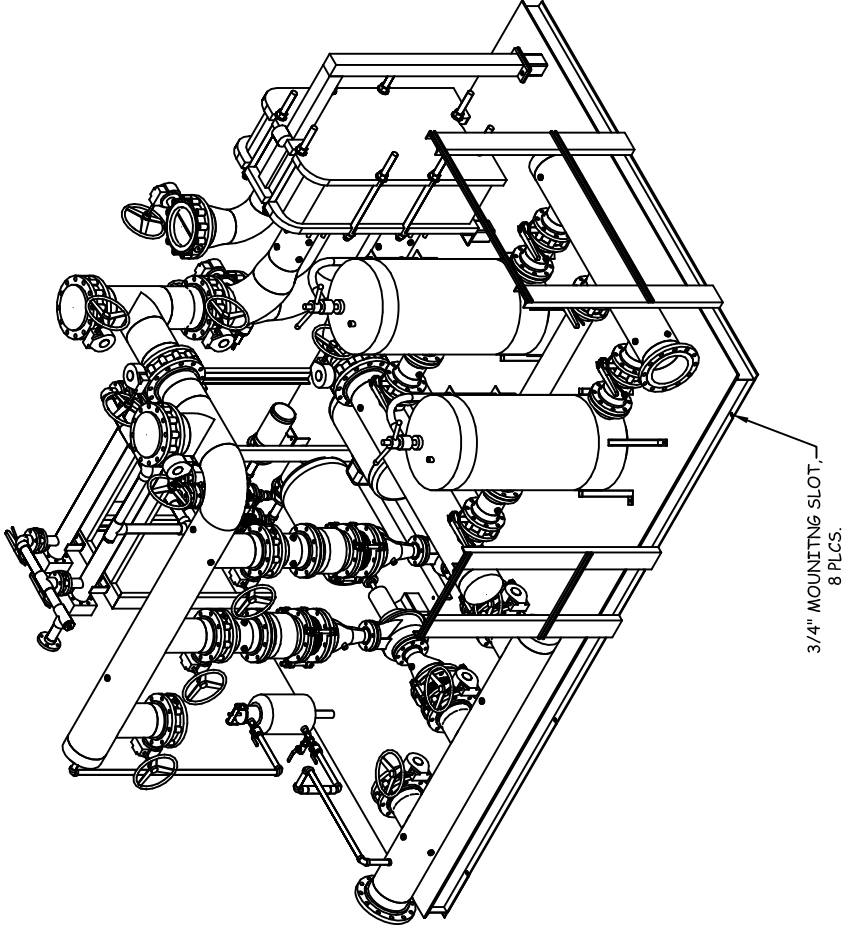

- DESIGN NOTES:
- (1) COMPLETE SYSTEM TO BE HYDRO TESTED TO 125 PSI PRIOR TO SHIPPING.
 - (2) STEEL FRAME AND COMPONENTS TO RECEIVE TWO COATS OF GRAY MACHINE ENAMEL.
 - (3) ALL WELDED WATER PIPING TO BE WELDED IN ACCORDANCE TO ASME B31.9
 - (4) COMPLETE PACKAGE SYSTEM TO BE UL LISTED.

= DENOTES CONTRACTOR POINT OF CONNECTION

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF FLOWTHERM SYSTEMS, A DIVISION OF CALIFORNIA HYDRONICS CORP. COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CALIFORNIA HYDRONICS CORP.

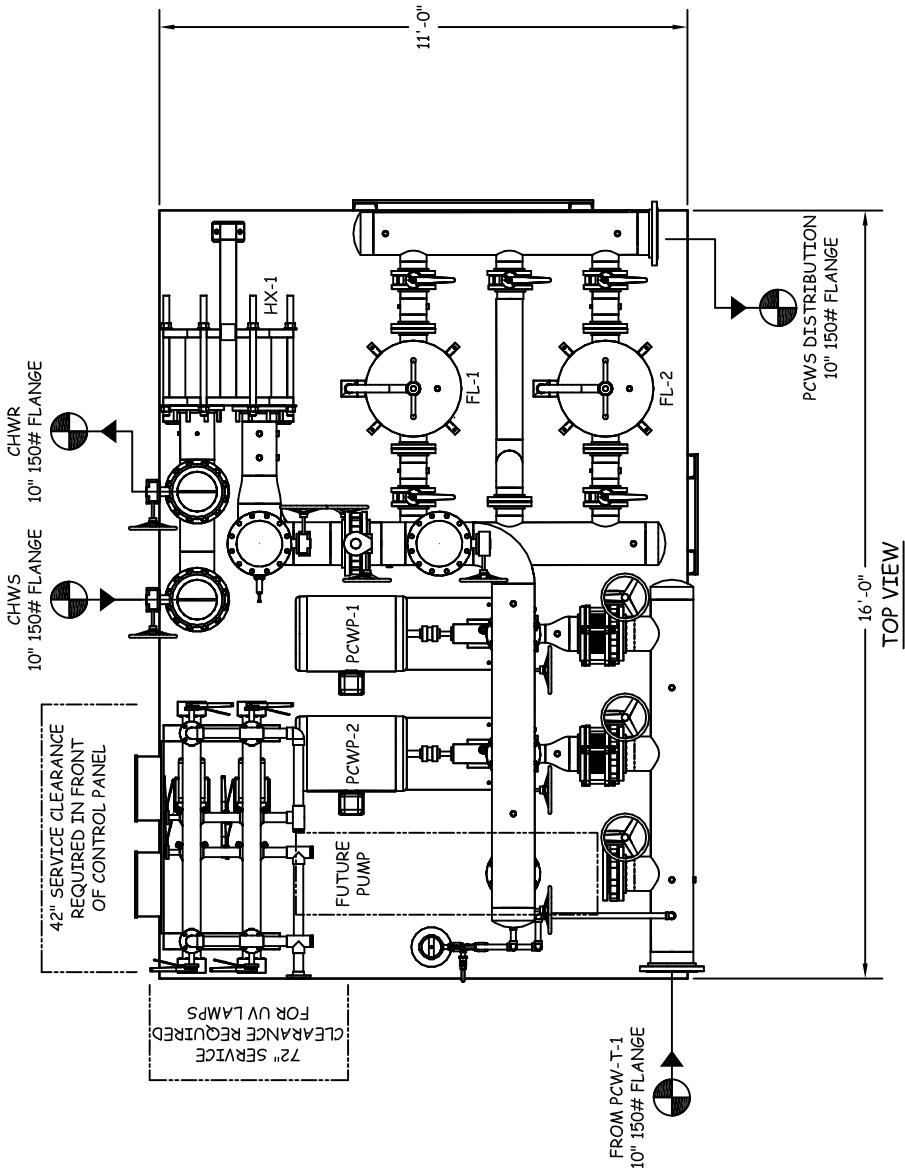

LISTED
PACKAGED PUMPING SYSTEMS
&
HEAT TRANSFER SYSTEMS

APPROXIMATE SHIPPING WEIGHT: LBS.
APPROXIMATE OPERATING WEIGHT: LBS.

REV	DESCRIPTION	BY	DATE

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF FLOWTHERM SYSTEMS, A DIVISION OF CALIFORNIA HYDRONICS CORP. COPIES ARE ISSUED IN STRICT CONFIDENCE AND SHALL NOT BE REPRODUCED OR COPIED, OR USED AS THE BASIS FOR THE MANUFACTURING OR SALE OF PRODUCT WITHOUT PRIOR WRITTEN PERMISSION OF CALIFORNIA HYDRONICS CORP.

CONTRACTOR:

JOB NAME:

DRAWING TITLE: PROCESS COOLING PACKAGE

DRAWING No. FAB No. REV

DRWN. DATE CKD. APPROVED

TOLERANCES UNLESS OTHERWISE SPECIFIED

DEC. .500" FRA. 1/2" ANGLE 5° SIZE D SCALE