



DCWS 2-1/2" 150# FLANGE
DTWS 2-1/2" 150# FLANGE

DHWS 1-1/2" F-NPT
DTWR 1" F-NPT

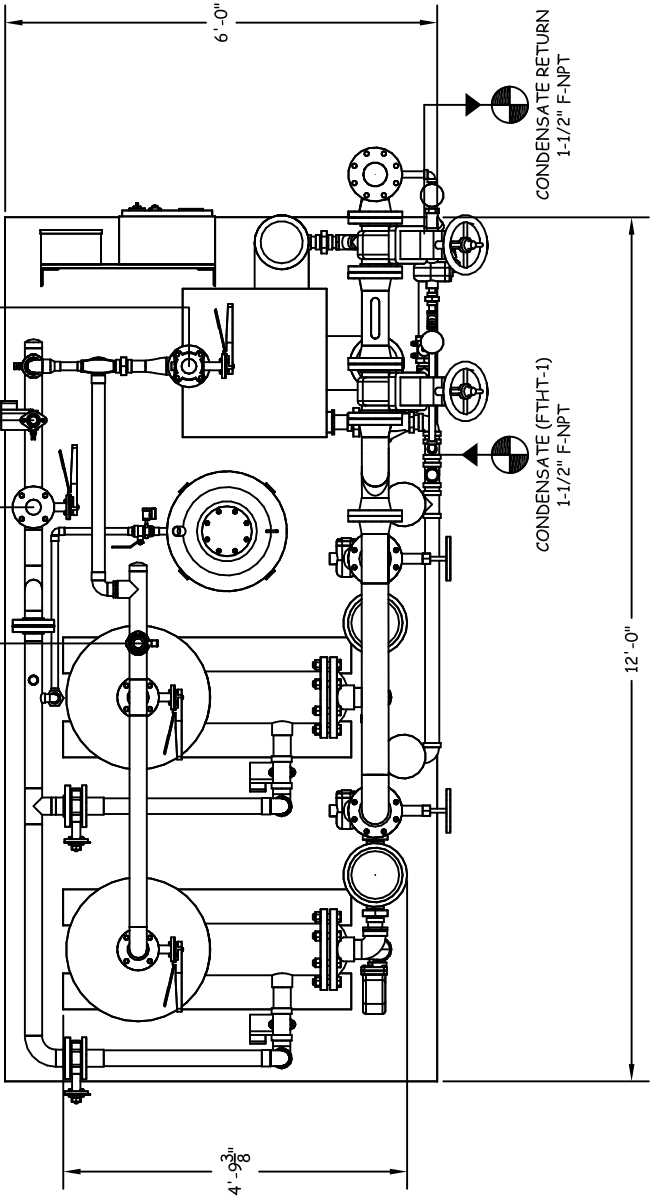


TOP VIEW


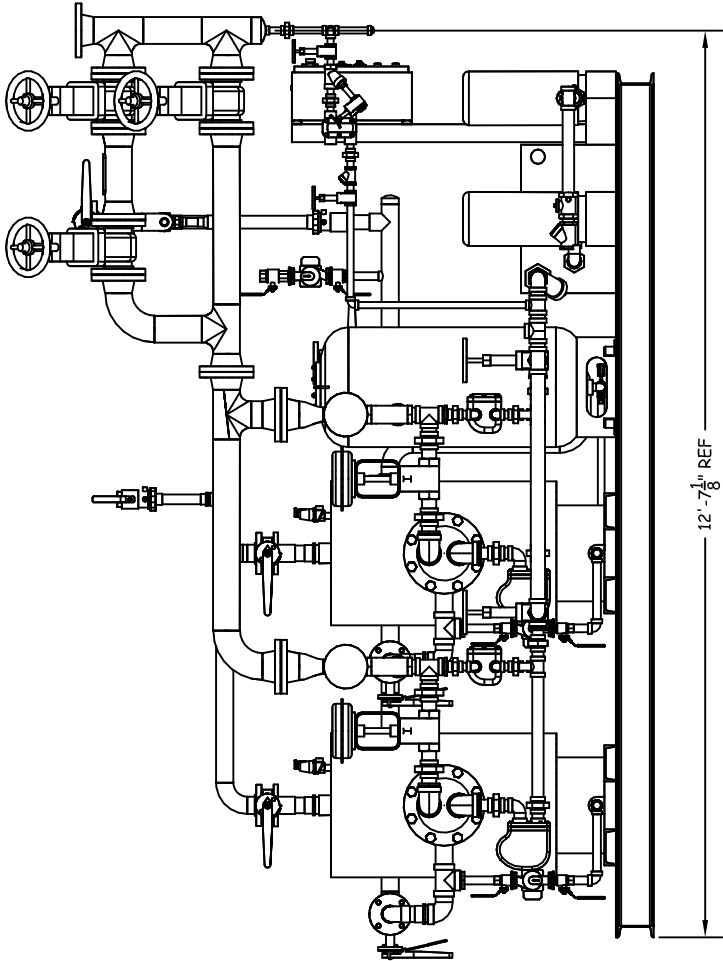


FRONT VIEW

STEAM INLET
4" 150# FLANGE

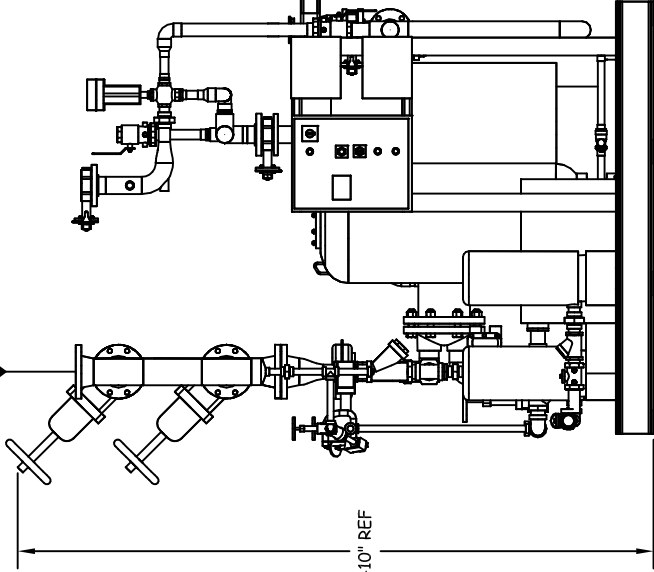

RIGHT END VIEW

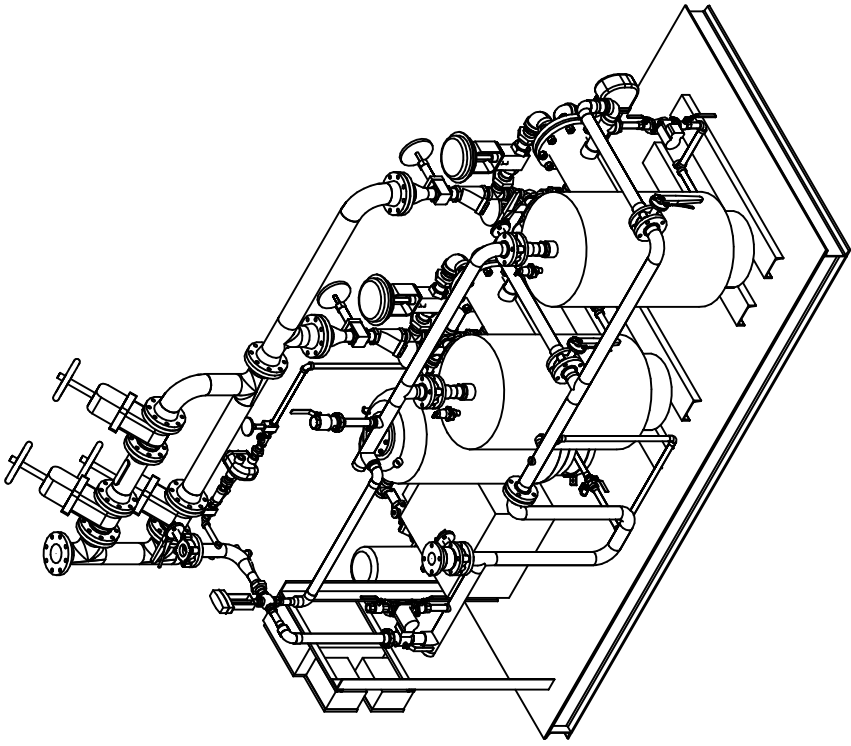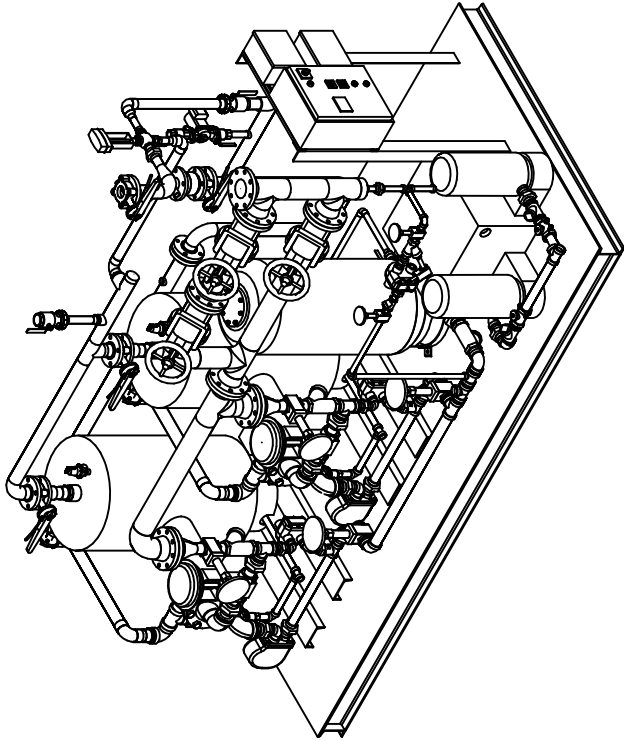

PIPE SUPPORTS TO BE INSTALLED
AS REQUIRED. SOME NOT SHOWN
FOR CLARITY

RELIEF VALVES AND EQUIPMENT
DRAINS TO BE PPED TO DRAIN OR
VENT BY CONTRACTOR PER CODE
REQUIREMENT

ALL BOLTING AND ANCHORING TO
BE IN COMPLIANCE WITH LOCAL
CODES AND ANY SEISMIC
REQUIREMENT

DESIGN NOTES:

- (1) COMPLETE SYSTEM TO BE HYDRO TESTED TO 125 PSI PRIOR TO SHIPPING.
- (2) STEEL FRAME AND COMPONENTS TO RECEIVE TWO COATS OF GRAY MACHINE ENAMEL.
- (3) ALL WELDED WATER PIPING TO BE WELDED IN ACCORDANCE TO ASME B31.9
- (4) COMPLETE PACKAGE SYSTEM TO BE UL LISTED.

⊕ = DENOTES CONTRACTOR POINT OF CONNECTION



LISTED
PACKAGED PUMPING SYSTEMS
&
HEAT TRANSFER SYSTEMS

THIS DRAWING AND THE INFORMATION
HEREON ARE THE PROPERTY OF
FLOWTHERM SYSTEMS, A DIVISION OF
CALIFORNIA HYDRONICS CORP. COPIES ARE
ISSUED IN STRICT CONFIDENCE AND SHALL
NOT BE REPRODUCED OR COPIED, OR USED AS
THE BASIS FOR THE MANUFACTURING OR SALE
OF PRODUCT WITHOUT PRIOR WRITTEN
PERMISSION OF CALIFORNIA HYDRONICS CORP.

JOB NAME:
UNIVERSITY OF OREGON ER8 MEMORIAL UNION
CONTRACTOR:
-

DRWN.
AM
DATE
04/14/14
CKD.
-
APPROVED
-
TOLERANCES UNLESS OTHERWISE SPECIFIED
DEC.
500"
FAC.
1/2"
ANGLE
5°
SIZE
D
SCALE
-

APPROXIMATE SHIPPING WEIGHT:
- LBS.
APPROXIMATE OPERATING WEIGHT:
- LBS.



FlowTherm
systems
HAYWARD, CALIFORNIA

DRAWING TITLE:

DOMESTIC HOT WATER PACKAGE SYSTEM (FTDW-1)

JOB No.
8D-14-006
DRAWING No.
FTDW-1 UnFO-ES8 MEMORIAL UNION

REV
B