
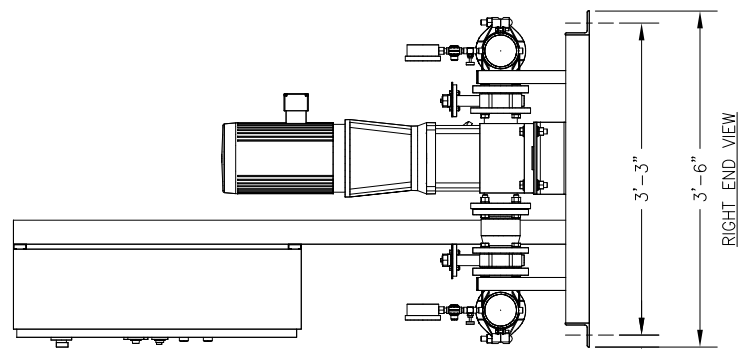
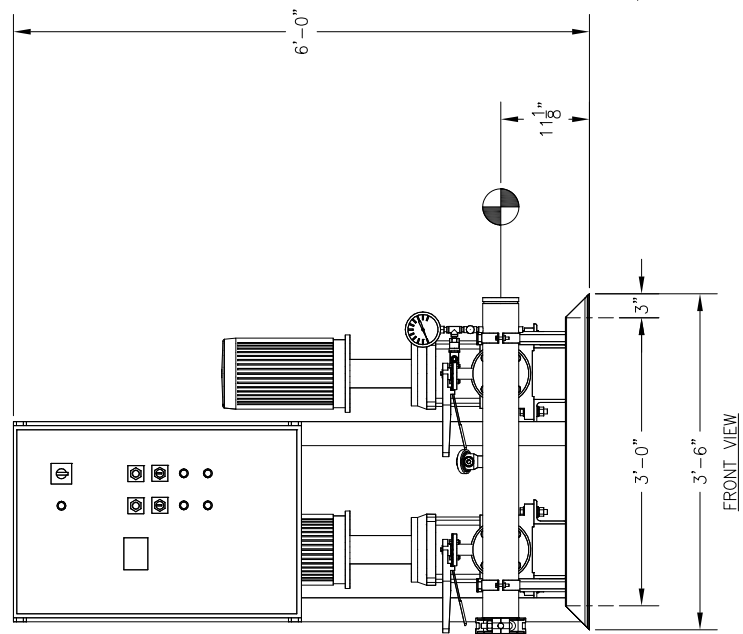
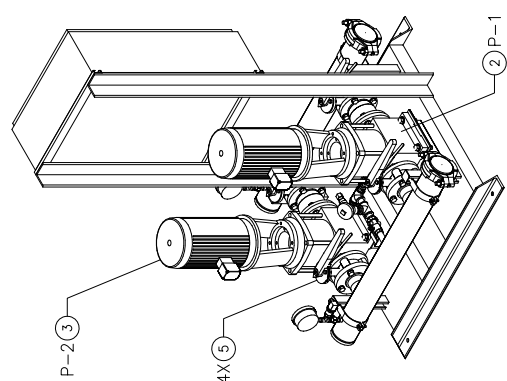
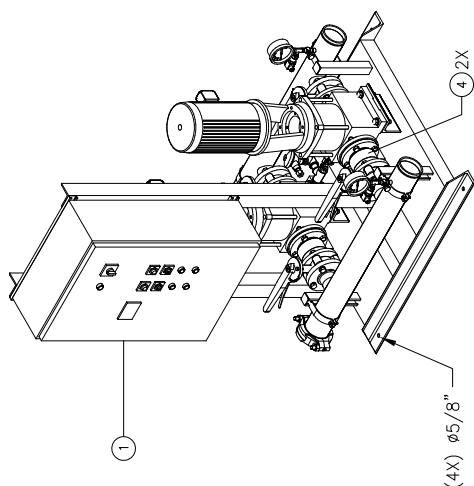


RELIEF VALVES AND  
EQUIPMENT DRAINS  
TO BE PIPIED TO DRAIN  
OR VENT BY CONTRACTOR  
PER CODE REQUIREMENT

ALL BOLTING AND ANCHORAGE  
TO BE IN COMPLIANCE WITH  
LOCAL CODES AND ANY  
SEISMIC REQUIREMENTS.

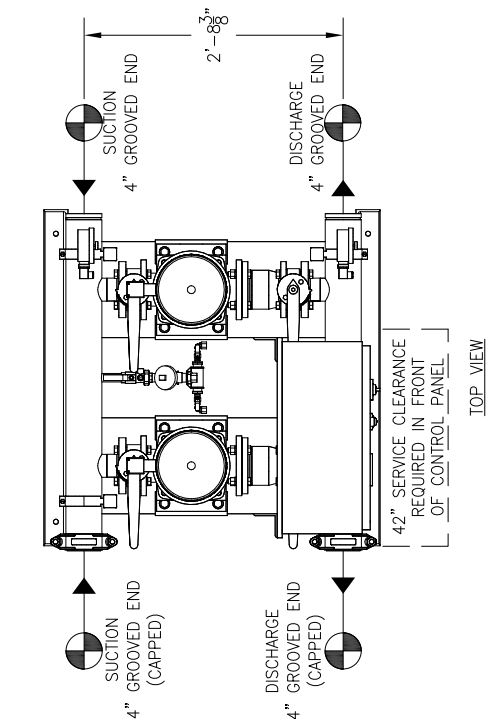

- CONSTRUCTION NOTES:
1. SUCTION AND DISCHARGE HEADERS ARE GROOVED ON BOTH ENDS.
  2. END CAPS CAN BE PLACED ON EITHER END OF HEADERS.
  3. SYSTEM DESIGNED FOR INDOOR INSTALLATION.

| TOTAL FLOW |  | - PSI |  | TOTAL DISCHARGE PRESSURE |  | - PSI |  | AVAILABLE PRESSURE |  |
|------------|--|-------|--|--------------------------|--|-------|--|--------------------|--|
|            |  |       |  |                          |  |       |  |                    |  |
|            |  |       |  |                          |  |       |  |                    |  |
|            |  |       |  |                          |  |       |  |                    |  |







GENERAL NOTES:

(1) SINGLE POINT POWER CONNECTION AT CONTROL PANEL.

(2) HYDRO PRESSURE CHECK AT 125 PSI.

(3) ASSEMBLED SYSTEM TO BE PAINTED WITH INDUSTRIAL MACHINE ENAMEL PRIOR TO SHIPMENT.

LISTED

PACKAGED PUMPING SYSTEMS  
& HEAT TRANSFER SYSTEMS

UL

PROJECT NAME:

CUSTOMER:

DRAWN BY DATE: 10/4/10/18

CHECKED BY: ACD

TOLERANCES UNLESS OTHERWISE SPECIFIED

DEC: .500"

FRAC: 1/2"

ANGLE: 5"

SCALE: 1" = 1'-0"

SIZE: C

EQUIPMENT SCHEDULE

| ITEM | QTY | TAG | DESCRIPTION                                     |
|------|-----|-----|-------------------------------------------------|
| 10   | -   | -   | -                                               |
| 9    | -   | -   | -                                               |
| 8    | -   | -   | -                                               |
| 7    | -   | -   | -                                               |
| 6    | -   | -   | -                                               |
| 5    | 4   | -   | LUG TYPE BUTTERFLY VALVE - 2 1/2"               |
| 4    | 2   | -   | VAL-MATIC GLOBE CHECK VALVE MODEL 1825 - 2 1/2" |
| 3    | 1   | P-2 | GOULDS ESV MULTI-STAGE PUMP MODEL 33SVG-2/2     |
| 2    | 1   | P-1 | GOULDS ESV MULTI-STAGE PUMP MODEL 33SVG-2/2     |
| 1    | 1   | -   | AQUALOGIC XL CONTROL PANEL                      |

DRAWING TITLE:

FW2.0-9-XL - VARIABLE SPEED DUPLEX PRESSURE BOOSTER

FAB No.

DRAWING No.

FW2.0-9-XL

REV

1